



Telephone:0484-2623576
email-qcdlaluva@gmail.co

KERALA WATER AUTHORITY



QUALITY CONTROL DISTRICT LAB,ALUVA -683101 [NABL ACCREDITED]
WATER TEST REPORT

ULR NO:TC955221000048984F


Report of Issue Date: 07.05.2022

Customer Name &Address	Date of Receipt of Payment	29.04.2022
Rogatiomist Academy West Desom Aluva	Date of Sample received	29.04.2022
	Sample given by	Customer
	Sample Code	ALY/S/7252/4/22
	Sample Name	Water
	Sample Condition	Good
	Source of Sample	Well
	Sample Quantity	2 Litre
	Test performing dates :	From:30.04.22 to 04.05.22

Sl.N	Characteristics	Unit	Test Method	Acceptable Limit as per IS 10500-2012	Result
1	Colour	Pt Co. Units	IS 3025 (Part 4)-1983(Reaffirmed 2017)	5	1.0
2	Odour	-	IS 3025 (Part 5)-2018	Agreeable	Agreeable
3	Turbidity	(NTU)	IS 3025 (Part10)-1984(Reaffirmed 2017)	1.0	0.5
4	pH at --- 25°C	-	IS 3025 (Part 11)-1983(Reaffirmed 2017)	6.5 to 8.5	6.2
5	Total Alkalinity	(mg/litre)	IS 3025 (Part 23)-1986(Reaffirmed 2019)	200	4.1
6	Sulphate (as SO4)	(mg/litre)	APHA 23rd Edition 4500-SO4 Method E(Turbidimetric Method)	200	<1
7	Total Dissolved Solids (TDS)	(mg/litre)	IS 3025 (Part 16)-1984(Reaffirmed 2017)	500	5.0
8	Total Hardness (as CaCO3)	(mg/litre)	IS 3025 (Part21)-2009(Reaffirmed 2019)	200	4.0
9	Calcium (as Ca)	(mg/litre)	IS 3025 (Part 40)-1991(Reaffirmed 2019)	75	<1
10	Magnesium (as Mg)	(mg/litre)	IS 3025 (Part 46)-1994(Reaffirmed 2019)	30	<1
11	Chloride (as Cl)	(mg/litre)	IS 3025 (Part 32)-1988(Reaffirmed 2019)	250	7.9
12	Iron (as Fe)	(mg/litre)	APHA 23rd Edition 3500 -Fe-Method B(Phenanthroline Method)	1	<0.1
13	Nitrate (as NO3)	(mg/litre)	APHA 23rd Edition(UV Screening Method) 2017	45	<1.0

Remarks:-

- NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer.
2) The samples retain for 15 days from the end date of analysis.
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory

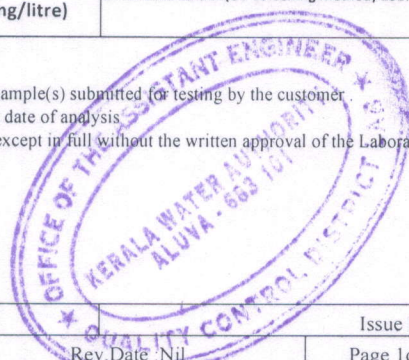

Authorized By

Veena M

Veena M

CHEMIST
Quality Control District Lab
Kerala Water Authority
Aluva

KWA/QCDL/ALY/01-2020	Issue Date : 04.10.2021
Ref No:Nil	Page 1of 1
Rev.Date Nil	

End of Report



Telephone:0484-2623576
email:-qcdlaluva@gmail.co

KERALA WATER AUTHORITY
QUALITY CONTROL DISTRICT LAB,ALUVA -683101
WATER TEST REPORT

Report No: KWA/QCDL-A/S/7252/21-22

Report of Issue Date: 07.05.2022

Customer Name & Address Rogatiomist Academy West Desom Aluva	Date of Receipt of Payment	29.04.2022
	Date of Sample received	29.04.2022
	Sample given by	Customer
	Sample Code	ALY/S/7252/4/22
	Sample Name	Water
	Sample Condition	Good
	Source of Sample	Well
	Sample Quantity	2 Litre
Test performing dates : From:30.04.22 to 04.05.22		

Sl.No	Characteristics	Unit	Test Method	Acceptable Limit as per IS 10500-2012	Result
1	Fluoride (as F)	(mg/litre)	IS 3025 (Part 60)-2008(Reaffirmed 2013)	1	
2	Acidity	(mg/litre)	IS 3025 (Part 22)-1986(Reaffirmed 2019)		
3	Electrical conductivity at 25° C	(micromhos/cm)	IS 3025 (Part 14)-2013(Reaffirmed 2019)	-	10
4	Residual Chlorine	(mg/litre)	IS 3025 (Part 26)-1986(Reaffirmed 2019)	0.2	

Remarks:-


- NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .
2) The samples retain for 15 days from the end date of analysis
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory

Authorized By

Veena
CHEMIST
Quality Control District Lab
Kerala Water Authority
Aluva

Veena M

KWA/QCDL/ALY/01-2020	Issue Date : 04.10.2021
Ref No:Nil	Page 1 of 1

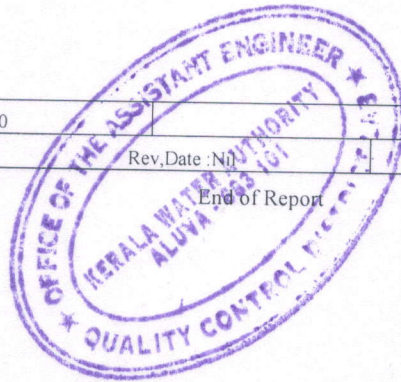

End of Report



Telephone:0484-2623576
email:-qcldaluva@gmail.co

KERALA WATER AUTHORITY
QUALITY CONTROL DISTRICT LAB,ALUVA -683101
WATER TEST-BACTERIOLOGY REPORT

Report No: KWA/QCDL-A/S/7252/21-22

Report of Issue Date: 07.05.2022

Customer Name & Address		Date of Receipt of Payment	29.04.2022	
Rogatiomist Academy West Desom Aluva		Date of Sample received	29.04.2022	
		Sample given by	Customer	
		Sample Code	ALY/S/7252/4/22	
		Sample Name	Water	
		Sample Condition	Good	
		Source of Sample	Well	
		Sample Quantity	125ml	
		Test performing dates :		From:29.04.22 to 30.04.22
Sl. No.	Source	No of Coliforms per 100ml of sample	E Coli n 100 ml of sample	
1	Water sample submitted by the customer	More than 100 CFU/100ml	Absent	

Remarks:-

- NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .
2) The samples retain for 15 days from the end date of analysis
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory

Authorized By

KWA/QCDL/ALY/01-2020	Issue Date : 04.10.2021
Ref No:Nil	Page 1 of 1

End of Report

